



BRIDGEWATER TOWNSHIP BUREAU OF FIRE SAFETY

100 COMMONS WAY BRIDGEWATER, NJ 08807

P: 908-725-6300 EXT 5550 Main Extension

EXT 5555 Chief Fire Marshal

FAX: 908-725-3817

EMAIL: firesafety@bridgewater.nj.gov

fireofficial@bridgewater.nj.gov

Karl W. McAleer, Chief Fire Marshal

APPLICATION FOR INSPECTION OF

SMOKE/CARBON MONOXIDE ALARMS & PORTABLE FIRE EXTINGUISHER COMPLIANCE INSPECTION

PROPERTY IS: ___ Single Family Home ___ 2 Family Home ___ 3 Family ___ Condo ___ Townhouse

PROPERTY IS: ___ SALE ___ RENTAL ___ LEASED PROPERTY

LOCATION OF INSPECTION: _____ BLOCK # _____ LOT# _____

NAME OF OWNER(S): _____

OWNER(S) ADDRESS: _____

HOME PHONE: _____ CELL PHONE: _____

EMAIL ADDRESS: _____

DO YOU WANT YOUR CERTIFICATE EMAILED? IF YES CHECK BOX

DATE OF CONSTRUCTION/YEAR BUILT: _____ CLOSING OR MOVE IN DATE: _____

REALTOR NAME: _____ NAME OF FIRM: _____

ADDRESS OF FIRM: _____

OFFICE PHONE: () _____ CELL () _____ EMAIL: _____

ATTORNEY NAME: _____ NAME OF FIRM: _____

ADDRESS OF FIRM: _____ CITY: _____ STATE: _____ ZIP/COE: _____

OFFICE PHONE: () _____ EMAIL: _____

PERSON COMPLETING APPLICATION SIGNATURE _____

CHECK ONE: ___ OWNER ___ REALTOR ___ ATTORNEY ___ OTHER

OPEN BUILDING PERMITS VERIFIED CLOSED BY BUILDING DEPT./FIRE SAFETY ___ YES ___ NO

DATE RECEIVED: _____ PAID: \$60 \$90 \$170 CASH ___ CHECK# _____ CREDIT CARD _____

THE APPROPRIATE FEE IS FOR EACH DWELLING UNIT

Requests for a CSDMACFE received more than 10 business days prior to the change of occupant is \$60.00

Requests for a CSDMACFE received four to 10 business days prior to the change of occupant is \$90.00

Requests for a CSDMACFE received fewer than four business days prior to the change of occupant is \$170.00

After the 1st failure and a subsequent re-inspection is required and thereafter an additional fee of \$25.00 shall be **paid prior** to the 2nd re-inspection and so forth

FAILING TO HAVE ALARM SYSTEM ON TEST & OR UNABLE TO RESET CODES WILL RESULT IN A FAILURE & A RE-INSPECTION WILL BE REQUIRED.

Requests for waiver of CSDMACFE for house demolition/extensive construction permits shall be accompanied with application, affidavits from seller & buyer attorney's offices and a \$20.00 administrative fee.

PAYMENTS SHALL BE MADE BY CHECKS, EXACT CASH OR VISA, MASTERCARD, & DISCOVER.

****THERE IS A CONVENIENCE FEE FOR CREDIT CARDS ASSESSED BY MUNICPAY SERVICES.****

BASIC SMOKE DETECTOR REQUIREMENTS

At the time of change of occupancy by way of sale, lease or rent of a residential dwelling, the smoke detectors shall remain in compliance from the time when the house or building was built and/or any renovations and/or additions were permitted. Use the following requirements listed by year built for proper code compliance for inspections.

****14.4.7 Replacement of Smoke Alarms in One- and Two-Family Dwellings. NFPA 72-13**

14.4.7.1 Unless otherwise recommended by the manufacturer's published instructions, single- and multiple-station smoke alarms installed in one- and two-family dwellings shall be replaced when they fail to respond to operability tests but shall not remain in service longer than 10 years from the date of manufacture. (SIG-HOU)

14.4.7.2 * Combination smoke/carbon monoxide alarms shall be replaced when the end-of-life signal activates or 10 years from the date of manufacture, whichever comes first. (SIG-HOU)

***8.7.2 Alarms shall be replaced when either the end-of-life signal is activated or the manufacturer's replacement date is reached. Alarms shall also be replaced when they fail to respond to operability tests. NFPA 720-15

Homes built prior to January 1977: Battery operated smoke detector on each level including the basement. Where there are bedrooms, the detector shall be installed within 10 feet of all bedroom doors. **Ten-year sealed battery-powered single station smoke alarms shall be installed where no smoke alarms or detection devices exist or when replacing similar battery-powered single station smoke alarms. However, A/C-powered single or multiple-station smoke alarms installed as part of the original construction or rehabilitation project shall not be replaced with battery-powered smoke alarms.**

Homes built from January 1977 to September 1978: Smoke detectors must be A/C powered (120 volt hardwired) on sleeping levels. Battery operated smoke detectors on all other levels. Where there are bedrooms, the detector shall be within 10 feet of all bedroom doors.

Homes built from October 1978 to January 1983: Smoke detectors must be A/C powered (120 volt hardwired) on sleeping levels and the basement. Where there are bedrooms, the detector shall be within 10 feet of all bedroom doors. Battery operated smoke detectors on all other levels.

Homes built from February 1983 to July 1984: Smoke detectors must be A/C powered (120 volt hardwired) on all levels including the basement. Where there are bedrooms, the detector shall be within 10 feet of all bedroom doors.

Homes built from August 1984 to February 1991: Smoke detectors must be A/C powered (120 volt hardwired) one on each level including the basement, interconnected*. Where there are bedrooms, the detector shall be within 10 feet of all bedroom doors.

Homes built from March 1991 to the Present: Smoke detectors must be A/C powered (120 volt hardwired) with battery back-up. There shall be one on each level including the basement and inside each bedroom. Where there are bedrooms, the detector shall be within 10 feet of all bedroom doors. Detectors shall be interconnected*.

***(interconnected: The activation of one detector sends a signal to activate all of the detectors in the same residence or dwelling unit)**

Note: Where there is a supervised or monitored system installed where the age of the house or building is built 1977 to the present, the system shall be maintained during change of occupancy. If this system can not be maintained, a new 120 volt hardwired (and battery back up, if required) smoke detectors shall be installed based on the minimum construction codes in effect at the time of first occupancy. If there is a central or separate alarm notification appliance it shall be heard on all floors of the residence including the bedrooms when the door(s) is (are) closed and the basement.

BASIC CARBON MONOXIDE DETECTOR REQUIREMENTS

CO Detectors are required to be installed and/or mounted in the hallway or adjacent to the sleeping areas and bedrooms within 10 feet of the bedroom doors as per the manufacture specifications, installation instructions and N.F.P.A 720. These documents shall be presented to the inspector at the time of inspection to receive a Valid Certificate of Compliance. Battery operated CO Detectors are acceptable. Bedrooms containing fuel burning appliances are also required to have a CO alarm installed in the bedroom per NJ International Residential Code

ABC FIRE EXTINGUISHER REQUIREMENTS & FLOOR DIAGRAMS OF SMOKE /CO ALARMS INSTALLATION ON FOLLOWING PAGE.

“ABC” TYPE PORTABLE FIRE EXTINGUISHER REQUIREMENTS

At least one portable fire extinguisher shall be installed in all one and two family dwellings upon change of occupancy. For the purposes of this code, “portable fire extinguisher” – shall mean an operable portable device, carried, and operated by hand, containing an extinguishing agent that can be expelled under pressure for the purpose of suppressing or extinguishing fire, and which is installed in accordance with the following:

1. The extinguisher shall be within 10 feet of the kitchen and located in the path of egress;
2. The extinguisher shall be readily accessible and not obstructed from view;
3. The extinguisher shall be mounted using the manufacturer's hanging bracket so the operating instructions are clearly visible;
4. The extinguisher shall be an approved listed and labeled type with a minimum rating of 2A-10B:C and no more than 10 pounds;
5. The owner's manual or written operation instructions shall be provided during the inspection and left for the new occupant;
6. The extinguisher shall be serviced and tagged by a certified Division of Fire Safety contractor within the past 12 months or the seller must have a receipt for a recently purchased extinguisher; and
7. The top of the extinguisher shall not be more than five feet above the floor.

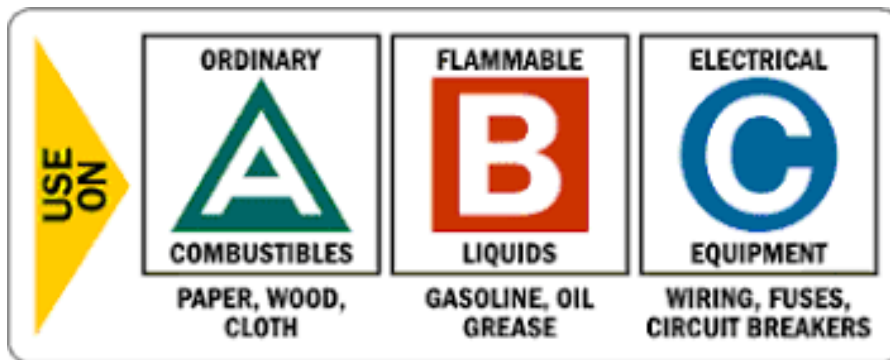


Figure 1

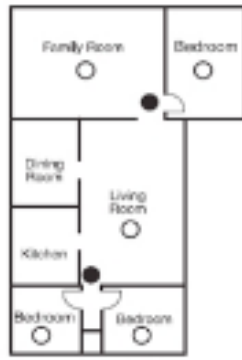


Figure 2



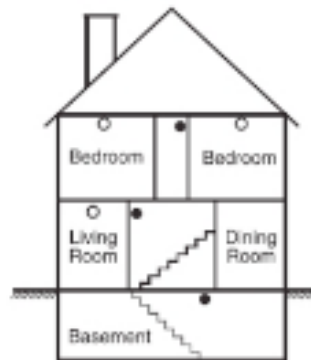


Figure 3

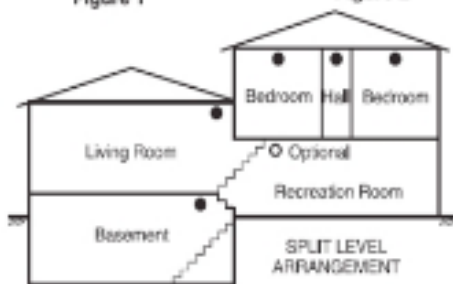

- Smoke detectors for better protection
- Smoke detectors for minimum protection

Figure 3a

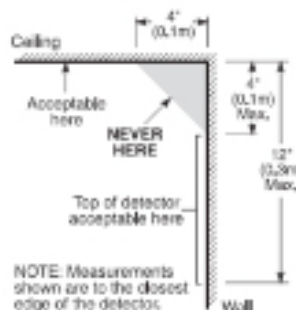

NOTE: Measurements shown are to the closest edge of the detector.

Figure 4